


IF RPBR IS INSIDE CHECK VALVE
HAS TO BE INSTALLED IN METER BOX.

SPRINKLERS
HOSE CONNECTIONS
(NO HOSES)
NO PRIVATE HYD.'S

DOUBLE CHECK VALVE ASSEMBLY
OR DOUBLE DETECTOR CHECK
VALVE ASSEMBLY INSTALLED.
ABOVE GROUND IN APPROVED
PREFAB BOX OR IN METRO WATER
SERVICE APPROVED UNDERGROUND
VAULT. (SEE DRAWING)

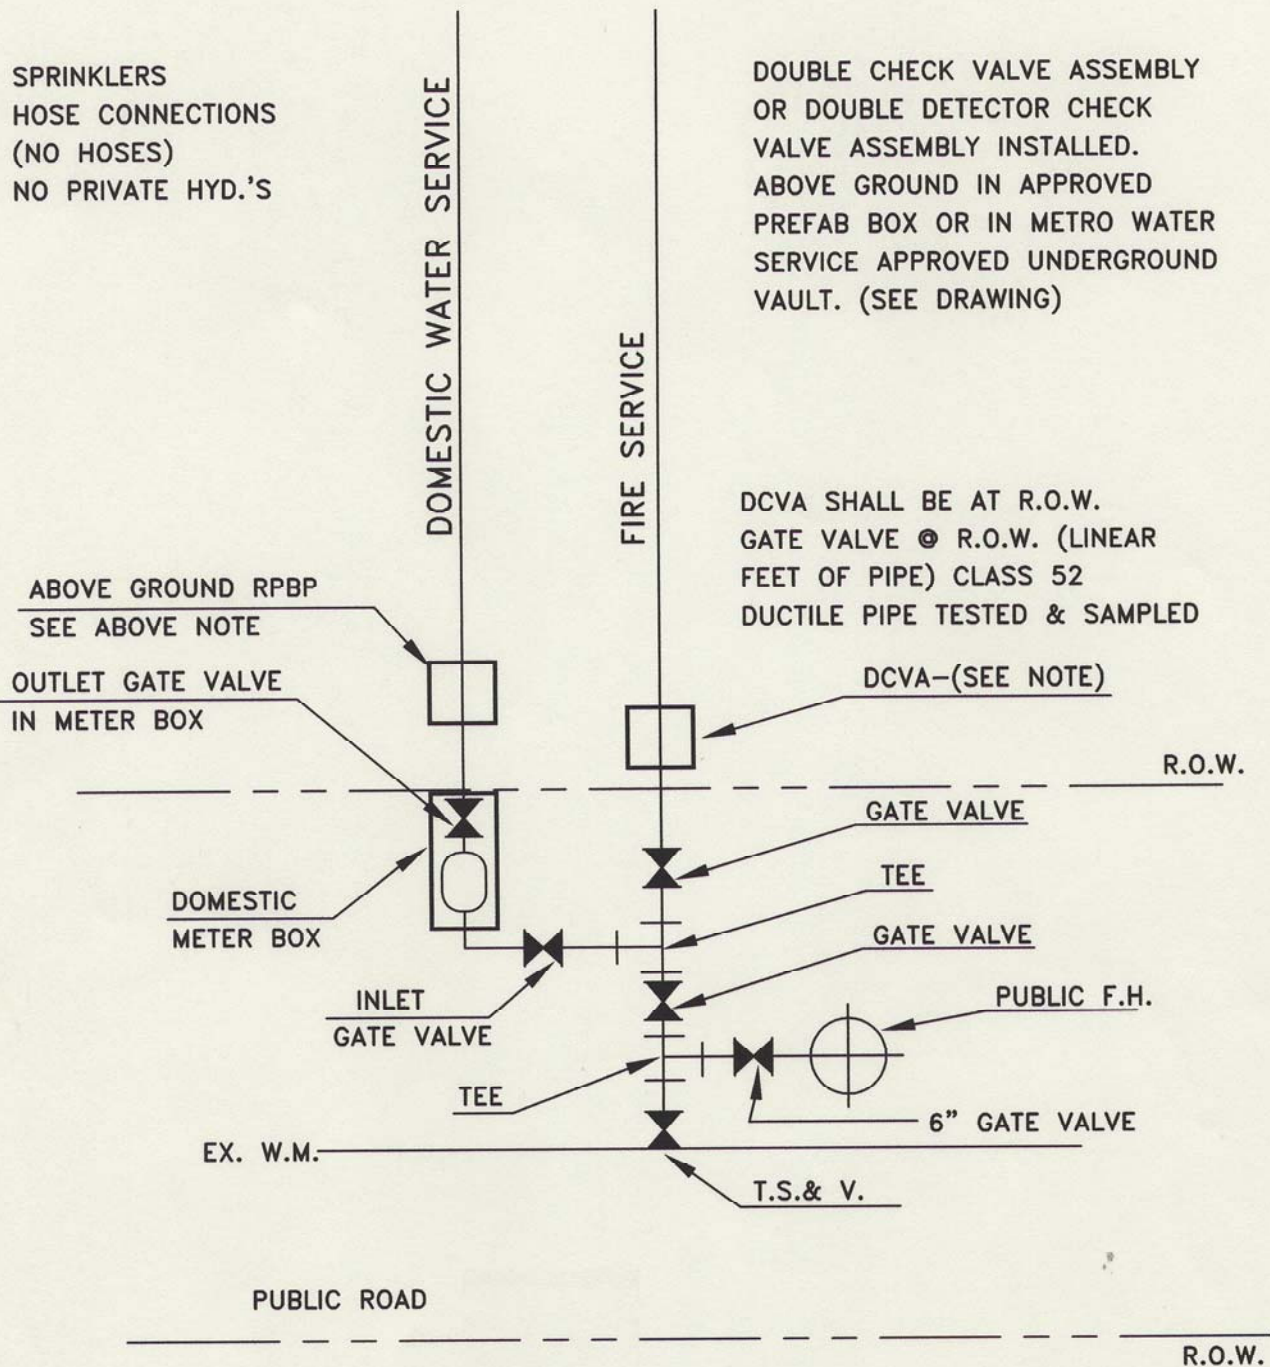

METRO WATER SERVICES

ALTERNATE 4", 6" OR 8"
DOMESTIC AND FIRE SERVICE

NOT TO SCALE | DATE: 2/25/05

DWG. NO. SCHEMATIC 7



Hal Balthrop
LICENSED DISTRIBUTION OPERATOR

[Signature]
DIRECTOR OF WATER AND SEWERAGE SERVICES